


General Notes
 A. DO NOT SCALE FROM THIS DRAWING. WORK ONLY FROM FIGURED DIMENSIONS.
 B. ALL ERRORS & OMISSIONS TO BE REPORTED TO THE CONSULTING ENGINEER
 C. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ARCHITECTS AND STRUCTURAL ENGINEERS DRAWINGS.
 D. REFER TO DOCUMENT REGISTER FOR DESCRIPTION OF STATUS CODES.

- NOTES**
- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS & CONTRACT DOCUMENTS.
 - THE INSTALLATION SHALL BE COMPLETED IN ACCORDANCE WITH ETO REGULATIONS, ESB NETWORKS NATIONAL CODE OF PRACTICE & LOCAL AUTHORITY REQUIREMENTS.
 - THE INSTALLATION SHALL BE COMPLETED IN ACCORDANCE WITH ETO REGULATIONS AND THE ESB NETWORKS NATIONAL CODE OF PRACTICE.
 - THE MECHANICAL & ELECTRICAL CONTRACTORS SHALL BE RESPONSIBLE FOR THE CO-ORDINATION OF ALL UNDERGROUND SERVICES IN CONJUNCTION WITH THE MAIN CONTRACTOR.
 - THE CONTRACTOR IS TO ALLOW FOR THE SUPPLY AND INSTALLATION OF ACCESS CHAMBERS ON DUCTING IN ACCORDANCE WITH ESB SPECIFICATION.
 - WIDE RADIUS & GENTLY SWEEPING BENDS TO BE USED ON DUCTING SET IN CONCRETE IN ACCORDANCE WITH ESB SPECIFICATION.
 - ALL ESB DUCTING TO BE LOCATED IN FOOTPATHS & SOFT LANDSCAPING.
 - ACCESS CHAMBERS SHALL BE INSTALLED ON DUCTING AS REQUIRED AT CHANGES IN DIRECTION & ON DUCT RUNS IN EXCESS OF 35m.
 - A MINIMUM COVER OF 600mm SHALL BE PROVIDED TO DUCTING IN GRASS MARGINS WITH A MINIMUM COVER OF 750mm PROVIDED AT ROAD CROSSINGS.
 - AT ALL TIMES THE CONTRACTOR IS TO BE AWARE OF THE PRESENCE OF EXISTING UNDERGROUND SERVICES IN THE VICINITY OF THE SITE.
 - REFER TO INDIVIDUAL HOUSE LAYOUT DRAWINGS FOR EXACT METER/ETU LOCATIONS.

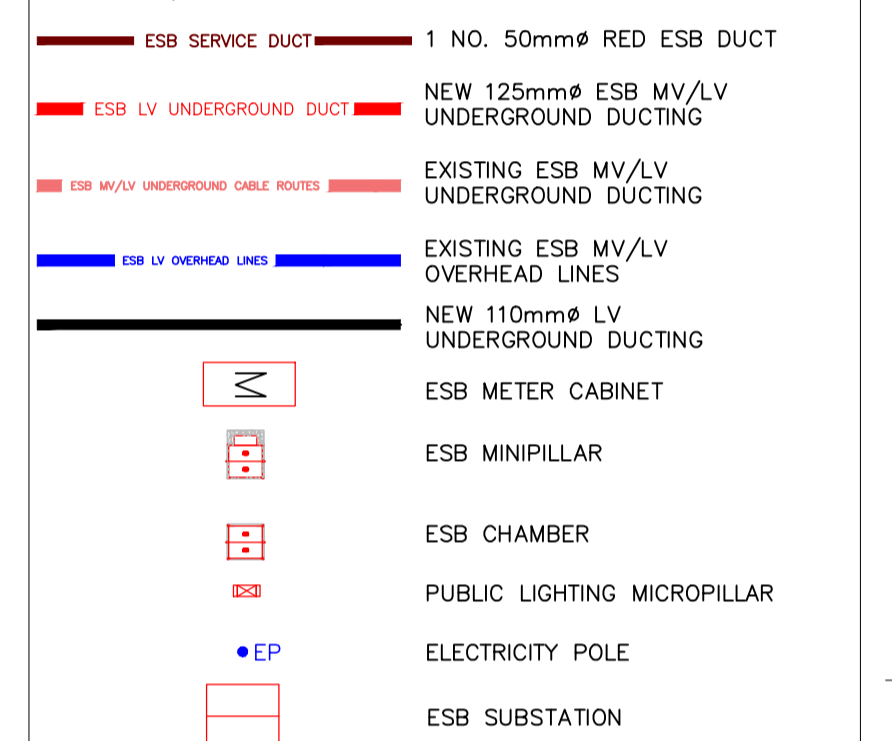

CAUTION:
 BEWARE OF EXISTING SERVICES. ESB NETWORKS TO BE PRESENT FOR ANY WORK TAKING PLACE IN CLOSE PROXIMITY TO THE EXISTING SUBSTATION
 IF CABLES ARE DAMAGED OR EXPOSED, CALL THE ESB EMERGENCY NETWORKS NUMBER 1850 372 999

Rev	Status	Date	Description	D.E.
P01	S5	Dec '22	Issue For Part VIII	C.MD
P03	S2	July '22	Stage 2	C.MD
P02	S2	Mar '22	Issue For Information	C.MD
P01	S2	Dec '21	Issue For Information	C.MD

Revision	Project Drawing Reference			
P01	21798-VCE-XX-XX-DR-E-1000			
Status	Varming Project Number			
S5	21798			
Date	Checked By	Drawn By	Scale	
DEC '21	J.G.	C.MD	1:100 @ A1	

Client
GALWAY CITY COUNCIL
 CITY HALL, COLLEGE ROAD, GALWAY CITY, H91 X4K8
 Project Title
DAY CENTRE FACILITIES AND EMERGENCY TEMPORARY HOMELESS ACCOMODATION SEAMUS QUIRKE ROAD, GALWAY CITY




Drawing Title
ELECTRICAL SERVICES PROPOSED UTILITY SERVICES INFRASTRUCTURE ESB NETWORKS LAYOUT



Dublin 01 4872300
 Cork 021 2375080
 Roscommon 090 6602380
 Website www.varming.ie

MEMBER IRELAND IHEEM

Engineering for the Future

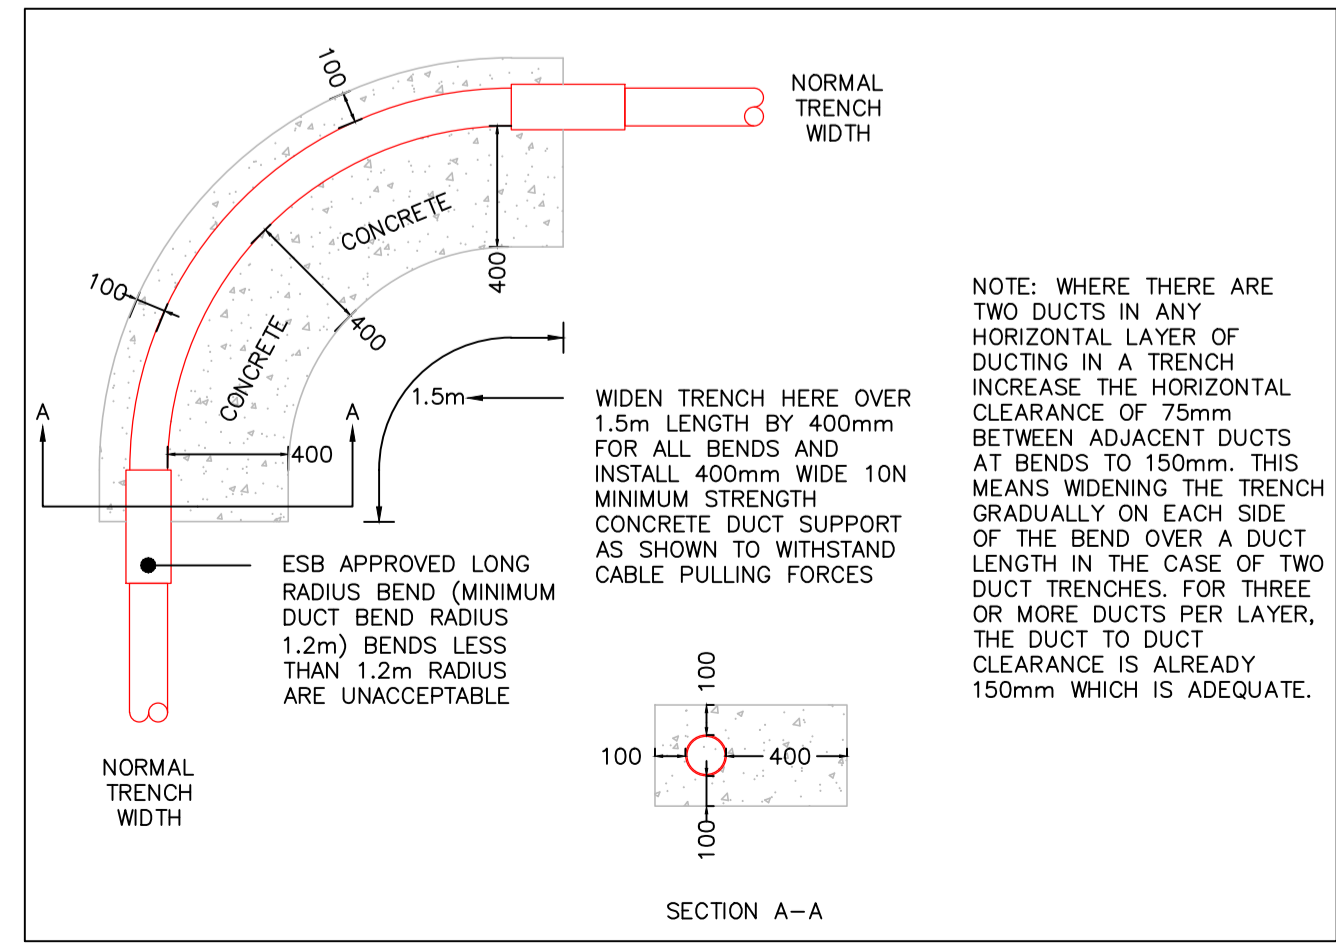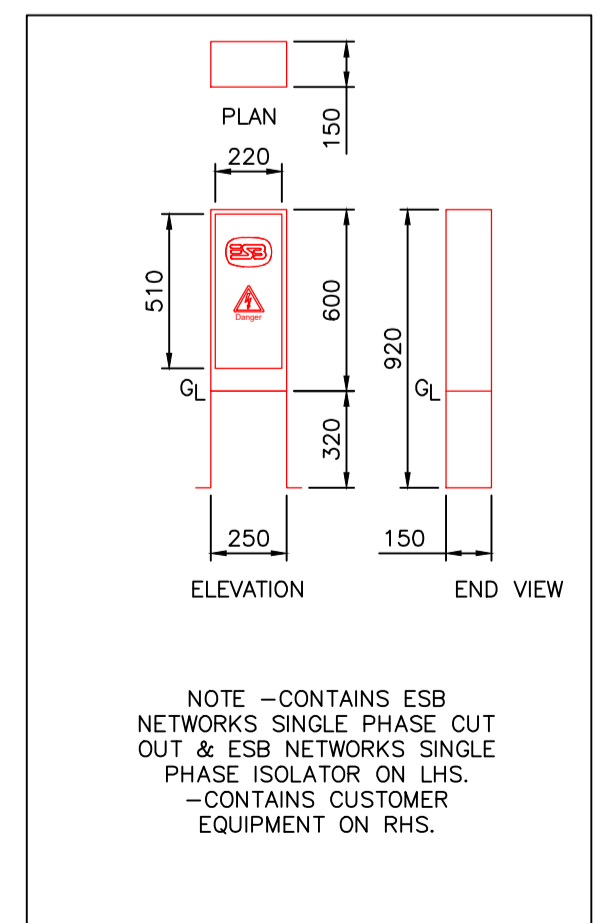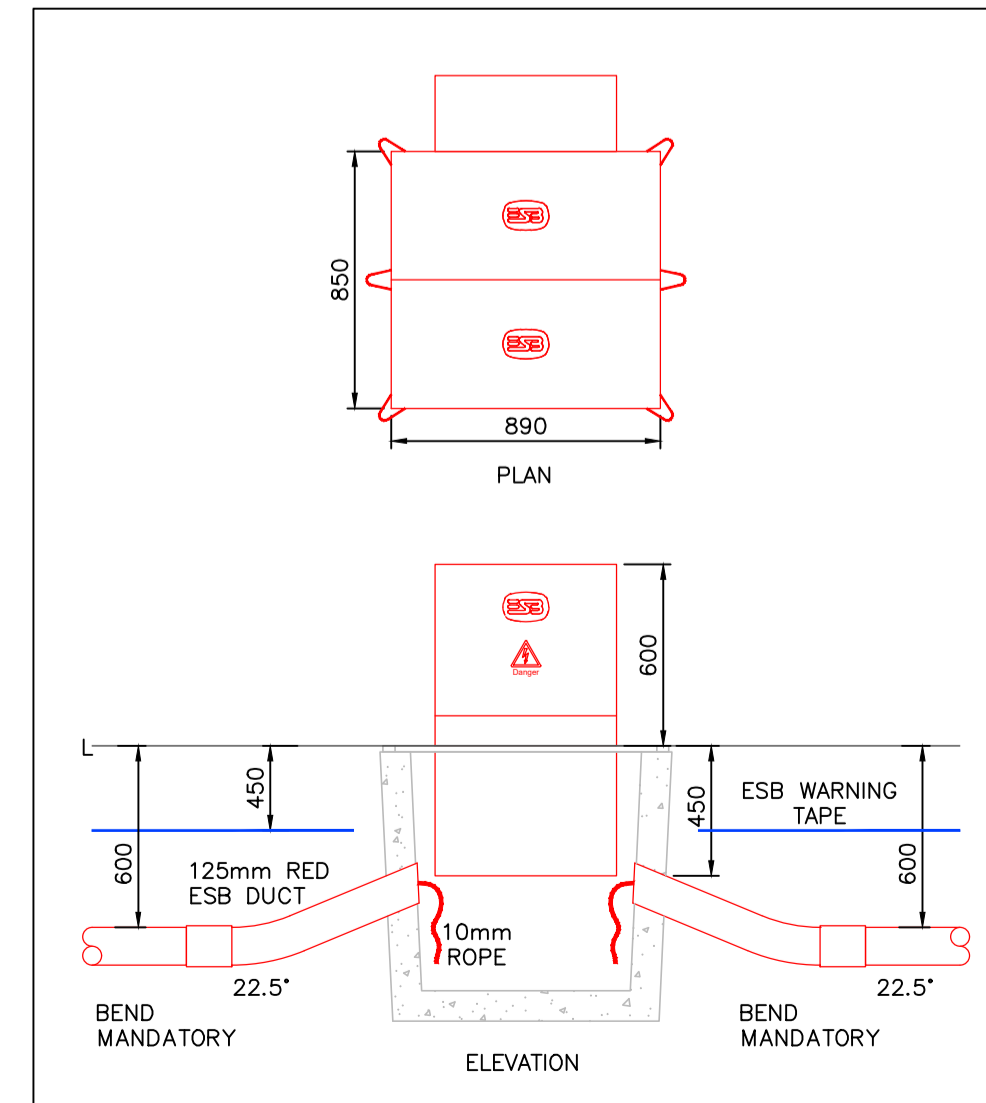

THE CONTRACTOR SHALL INSTALL AN ESB NETWORKS APPROVED 125mm, 22.5 DEGREE BEND ON EACH MAINS CABLE DUCT ON ENTRY OF DUCT TO A MINIPILLAR VAULT.

INSTALL EACH BEND FOR MAINS CABLE DUCTS AT AN UPWARD ANGLE TO ASSIST WITH CABLE PULLING. EACH BEND SHOULD BE CUT FLUSH WITH INTERNAL WALL OF VAULT.

INSTALL MAINS CABLE DUCTS THROUGH THE SIDE FACES OF THE MINIPILLAR VAULT ONLY.

INSTALL SERVICE CABLE DUCTS AT THE SAME LEVEL (600mm) OR BELOW THE LEVEL OF MAINS CABLE DUCTS.

INSTALL SERVICE CABLE DUCTS THROUGH THE SIDE FACES OF THE MINIPILLAR VAULT IN THE CLOSEST KNOCK OUT / OPENINGS TO THE MINIPILLAR.

MINIPILLAR BODY TO BE INSTALLED LEVEL, GROUND LEVEL MARK FLUSH WITH GROUND LEVEL AND FRONT FACE OF MINIPILLAR FLUSH WITH INSIDE LINE OF FOOTPATH.

BLOCK BUILT MINIPILLAR VAULTS ARE NOT ACCEPTABLE. PLASTIC VAULTS TO BE BACKFILLED WITH 15N CONCRETE.

MINIPILLAR VAULTS ARE TO BE BEDDED SECURELY.

MINIPILLAR VAULTS ARE TO BE CLEAN AND FREE FROM ANY OBSTRUCTIONS. THERE SHALL BE NO GAP BETWEEN THE VAULT AND MINIPILLAR.

PREFABRICATED MINI PILLAR VAULTS ARE TO BE INSTALLED ACCORDING TO DETAILED MANUFACTURER'S INSTRUCTIONS SUPPLIED WITH EACH UNIT.

MINIPILLARS TO BE INSTALLED WITH EARTHING AS PER ESB NETWORKS SPECIFICATION.

MINIPILLAR VAULT DETAIL
 1:25 (A1)