
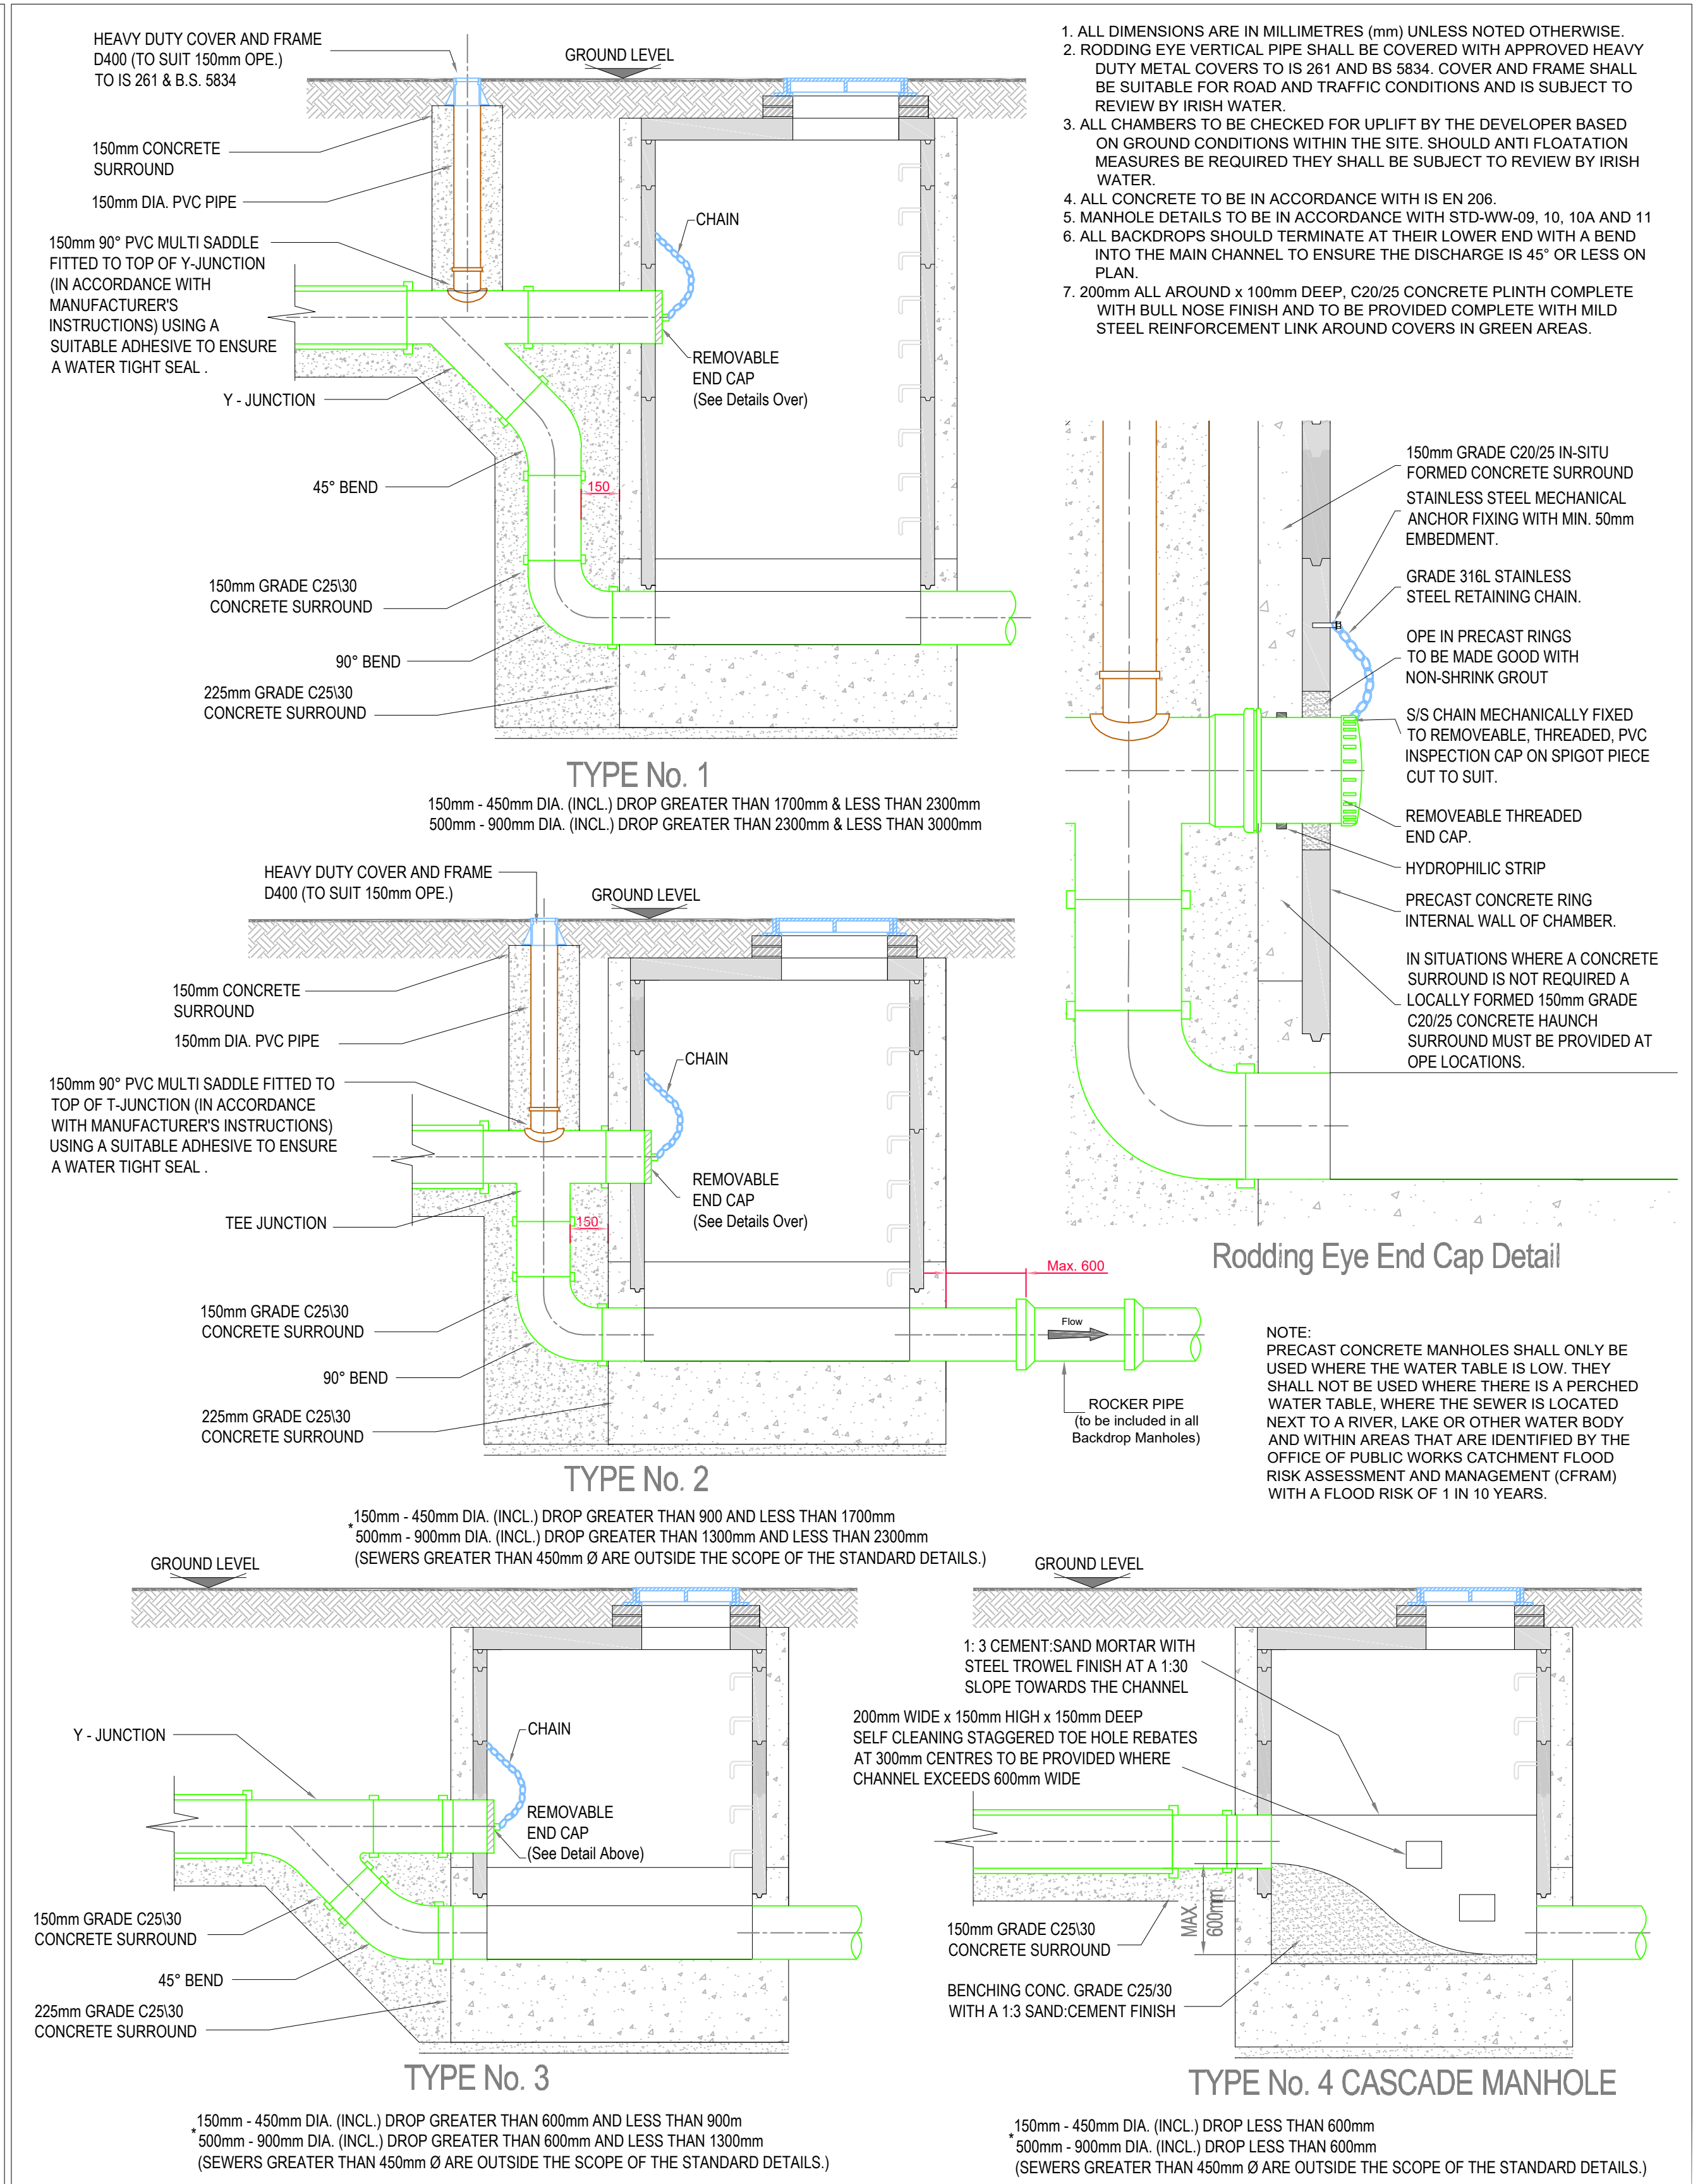


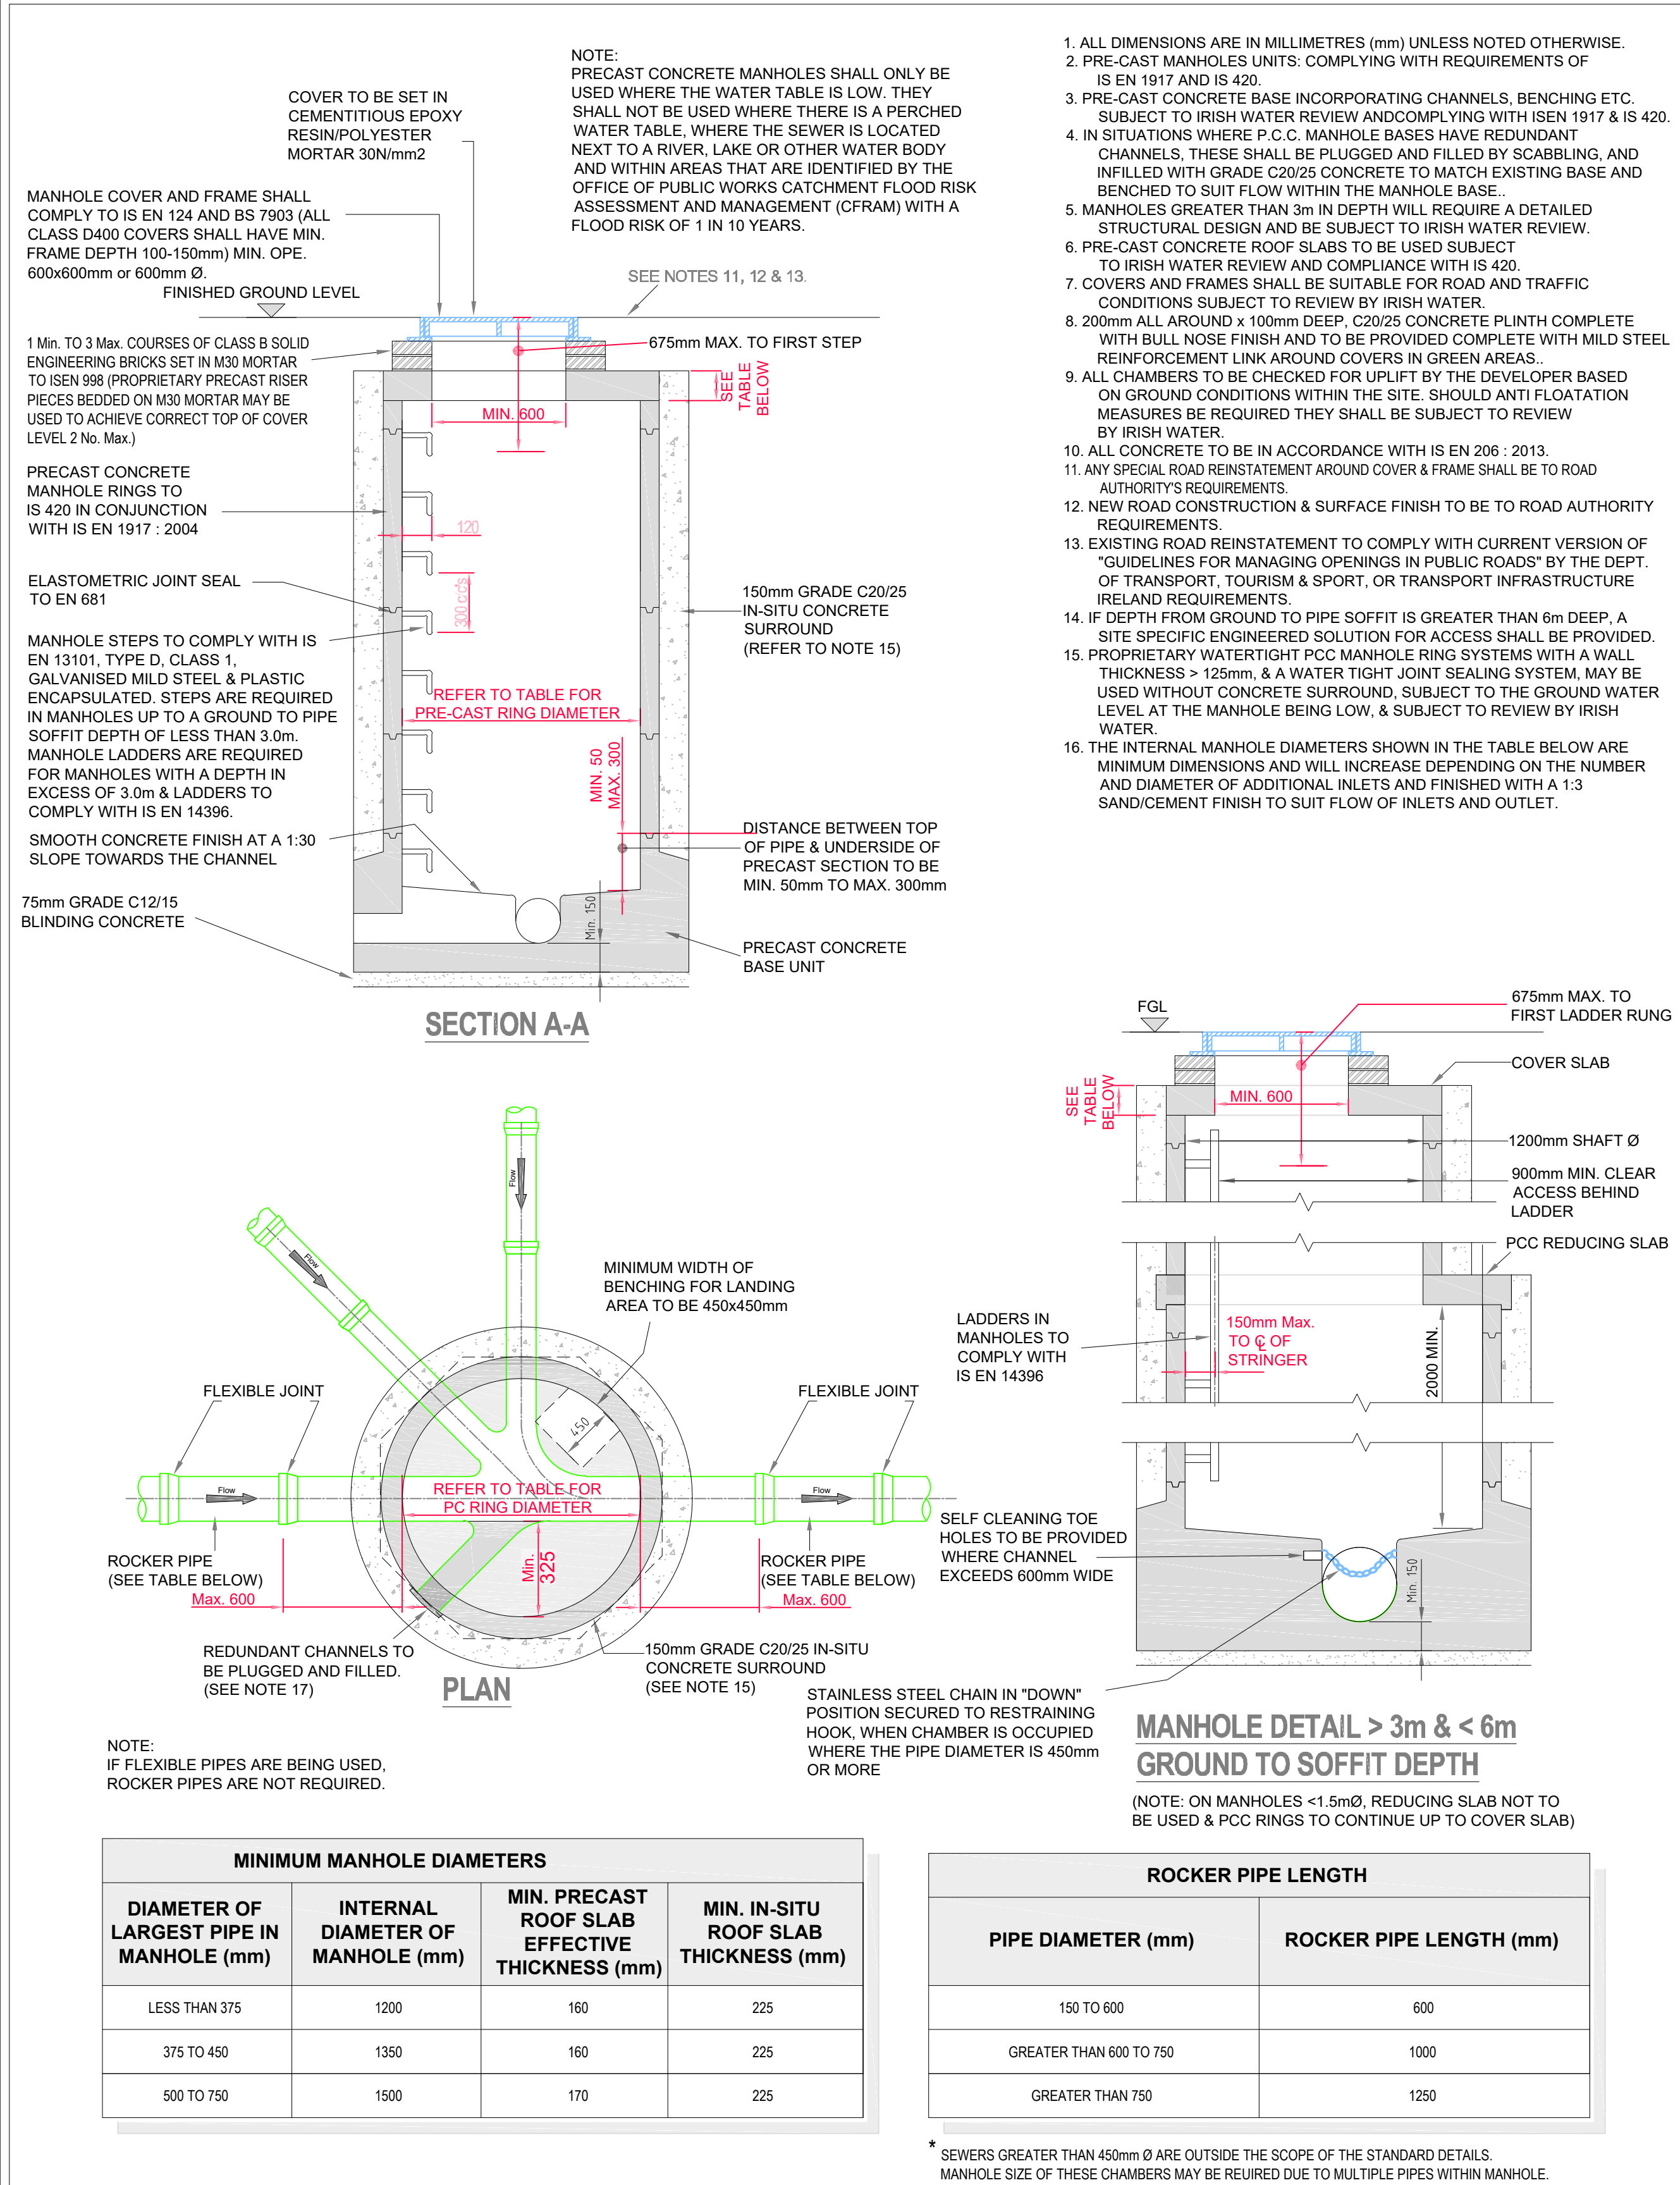

- Foul Sewer Notes:
- All foul sewer works shall be carried out in accordance with Irish Water Standard Details and Code of Practice for Wastewater Infrastructure Document CDS-5030-03.
 - All pipe materials shall comply with the Irish Water Code of Practice for Wastewater Infrastructure Document CDS-5030-03.
 - Foul sewer service connections and inspection chambers shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.
 - All manhole chambers shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.
 - Trench backfill and bedding shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.
 - Concrete bed, haunch and surround shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.
 - Separation distances from other services, boundary walls etc. shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.
 - Separation distances from trees, shrubs etc. shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.

- Storm Sewer Notes:
- All pipe materials shall comply with Irish Water Code of Practice for Wastewater Infrastructure Document CDS-5030-03.
 - All manhole chambers shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.
 - Trench backfill and bedding shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.
 - Concrete bed, haunch and surround shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.

- Watermain Notes:
- All watermain works shall be carried out in accordance with Irish Water Standard Details and Code of Practice for Water Infrastructure Document CDS-5020-03.
 - All pipe materials shall be in compliance with Section 3.9 of Irish Water Code of Practice Document-CDS-5020-03.
 - Individual water service connections and boundary boxes shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.
 - Separation distances from other services, boundary walls etc. shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.
 - Separation distances from trees, shrubs etc. shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.
 - On line and off-line air valve details shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.
 - Sluice valve details shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.
 - On line and off-line hydrant details shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.
 - Scour valve and chamber details shall be in accordance with Irish Water standard details as set out in IW Wastewater Infrastructure Standard Details document - IW-CDS-5030-01.

Rev	Date	By	CHK	Amendment / Issue	App
P04	31.08.21	OP	Wier	Issue for Stage Approval	OK

Client					
Galway City Council					
 MAKING COMPLEX EASY Lyrr 2, IDA Business & Technology Park, Mervue, Galway T +353 91 400200 W www.rpsgroup.com/ireland E ireland@rpsgroup.com					

Project	Housing Development , Keeraun, Ballymoneen Road, Galway				
---------	--	--	--	--	--

Title	TYPICAL WATERMAIN / DRAINAGE DETAILS				
-------	---	--	--	--	--

Model File Identifier	N/A				
-----------------------	-----	--	--	--	--

File Identifier	MGC0716-RPS-00-XX-DR-DR0004-03				
-----------------	--------------------------------	--	--	--	--

Created on	January '21	Sheets	04 of 05		
------------	-------------	--------	----------	--	--

Scale	NTS @ A1 NTS @ A3	Status	S4	Rev	P04
-------	----------------------	--------	----	-----	-----